QDAR- RECESS DROP LENS Installation Instruction

ERP: IIS00294 Date: 06/08/2023 Rev 3.0

NOTES

- Installation should be completed by an individual familiar with the construction and operation of the luminaire.
- Installation of luminaire must be in accordance with nation and local building and electrical codes.
- Carefully read and follow all warnings and instructions before installing or servicing the luminaire.
- Instructions do not cover all details and all possible product configurations
- Do not restrict luminaire ventilation.
- Ensure LED luminaire is not covered with material that will prevent convection or conduction cooling.
- Do not exceed luminaire's maximum ambient temperature.
- Ensure LED luminaire has the correct polarity before installation.
- Based on maximum voltage restrictions for class 2 circuits in Canadian Electrical Code, the output cannot be accessible. This product has accessible

WARNINGS

Electric shock:

installed in fixture.

- Burn:
- Allow luminaire to cool before handling luminaire.
- Disconnect or turn off power before installing or servicing luminaire. **Personal Injury:** Fixture should ONLY be powered on with access plate – Wear safety glass
 - Wear safety glasses and gloves when handling the luminaire to avoid physical injury.
 - Avoid direct eye contact with light source.
 - Always support the weight of the luminaire.
 - Intended Use:
 - Certain airborne contaminants can diminish integrity of acrylic and/or polycarbonate.
- voltage.

 Avoid exposing wiring to metal edges and sharp objects.
- Ensure that the luminaire is properly grounded to prevent electric hazards.

All electrical wiring to be completed by a qualified licensed electri-

Ensure supply voltage corresponds with the correct ballast/driver


cian in accordance with local and National/Canadian Electrical

Fire:

Code.


- Keep flammable and combustible materials away from the light source and/or lens.
- Use correctly rated supply conductors as indicated by product labeling.
- Certain airborne contaminants may also adversely affect the functioning of LEDs and other electronic components, depending on various factors such as concentrations of the containments, ventilation, and temperature at the end-user location.
- Failure due to the effect of contaminants is not covered under our standard terms of warranty.

Manufacturer is not responsible for any injuries due to the improper installation or handling of its products.

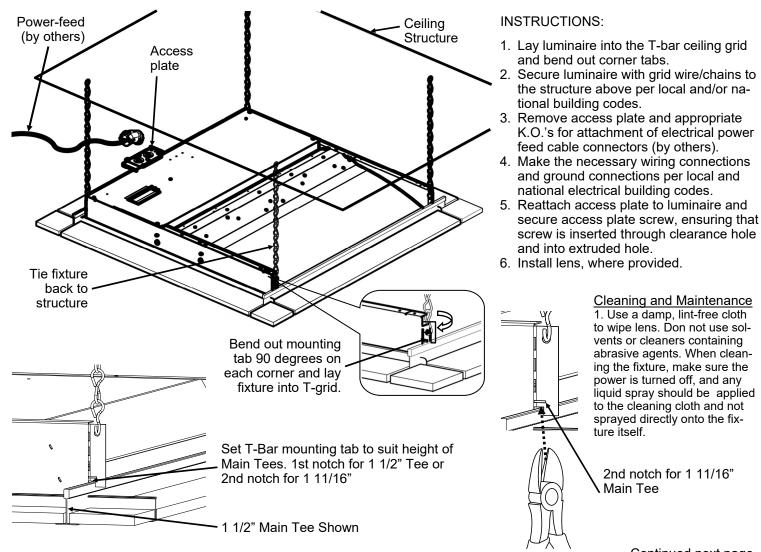


ERP: IIS00294 Date: 06/08/2023 Rev 3.0


Lens Installation



1. Begin with one side first. Squeeze, align and insert springs to bracket. Repeat same for the other sides.



2. Once all springs are properly installed, gently push the diffuser as far as the springs allow and installation complete. (Requires 2 persons)

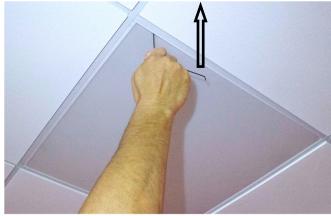


- 1. Insert spring (supplied-see Fig.1) through gap and 1/4 twist to catch bottom of lens.
- 2. Pull down gently and grip lens around perimeter to allow for disengagement of springs.



Fig. 1

Pop open adjacent ceiling tile and find location for spring when needed for removal of **Flush Lens**





Cleaning and Maintenance

1. Use a damp, lint-free cloth to wipe lens.

Flush Lens D0 Removal Only

Lens Height Adjustment Instruction

